


Floorplan RPL1

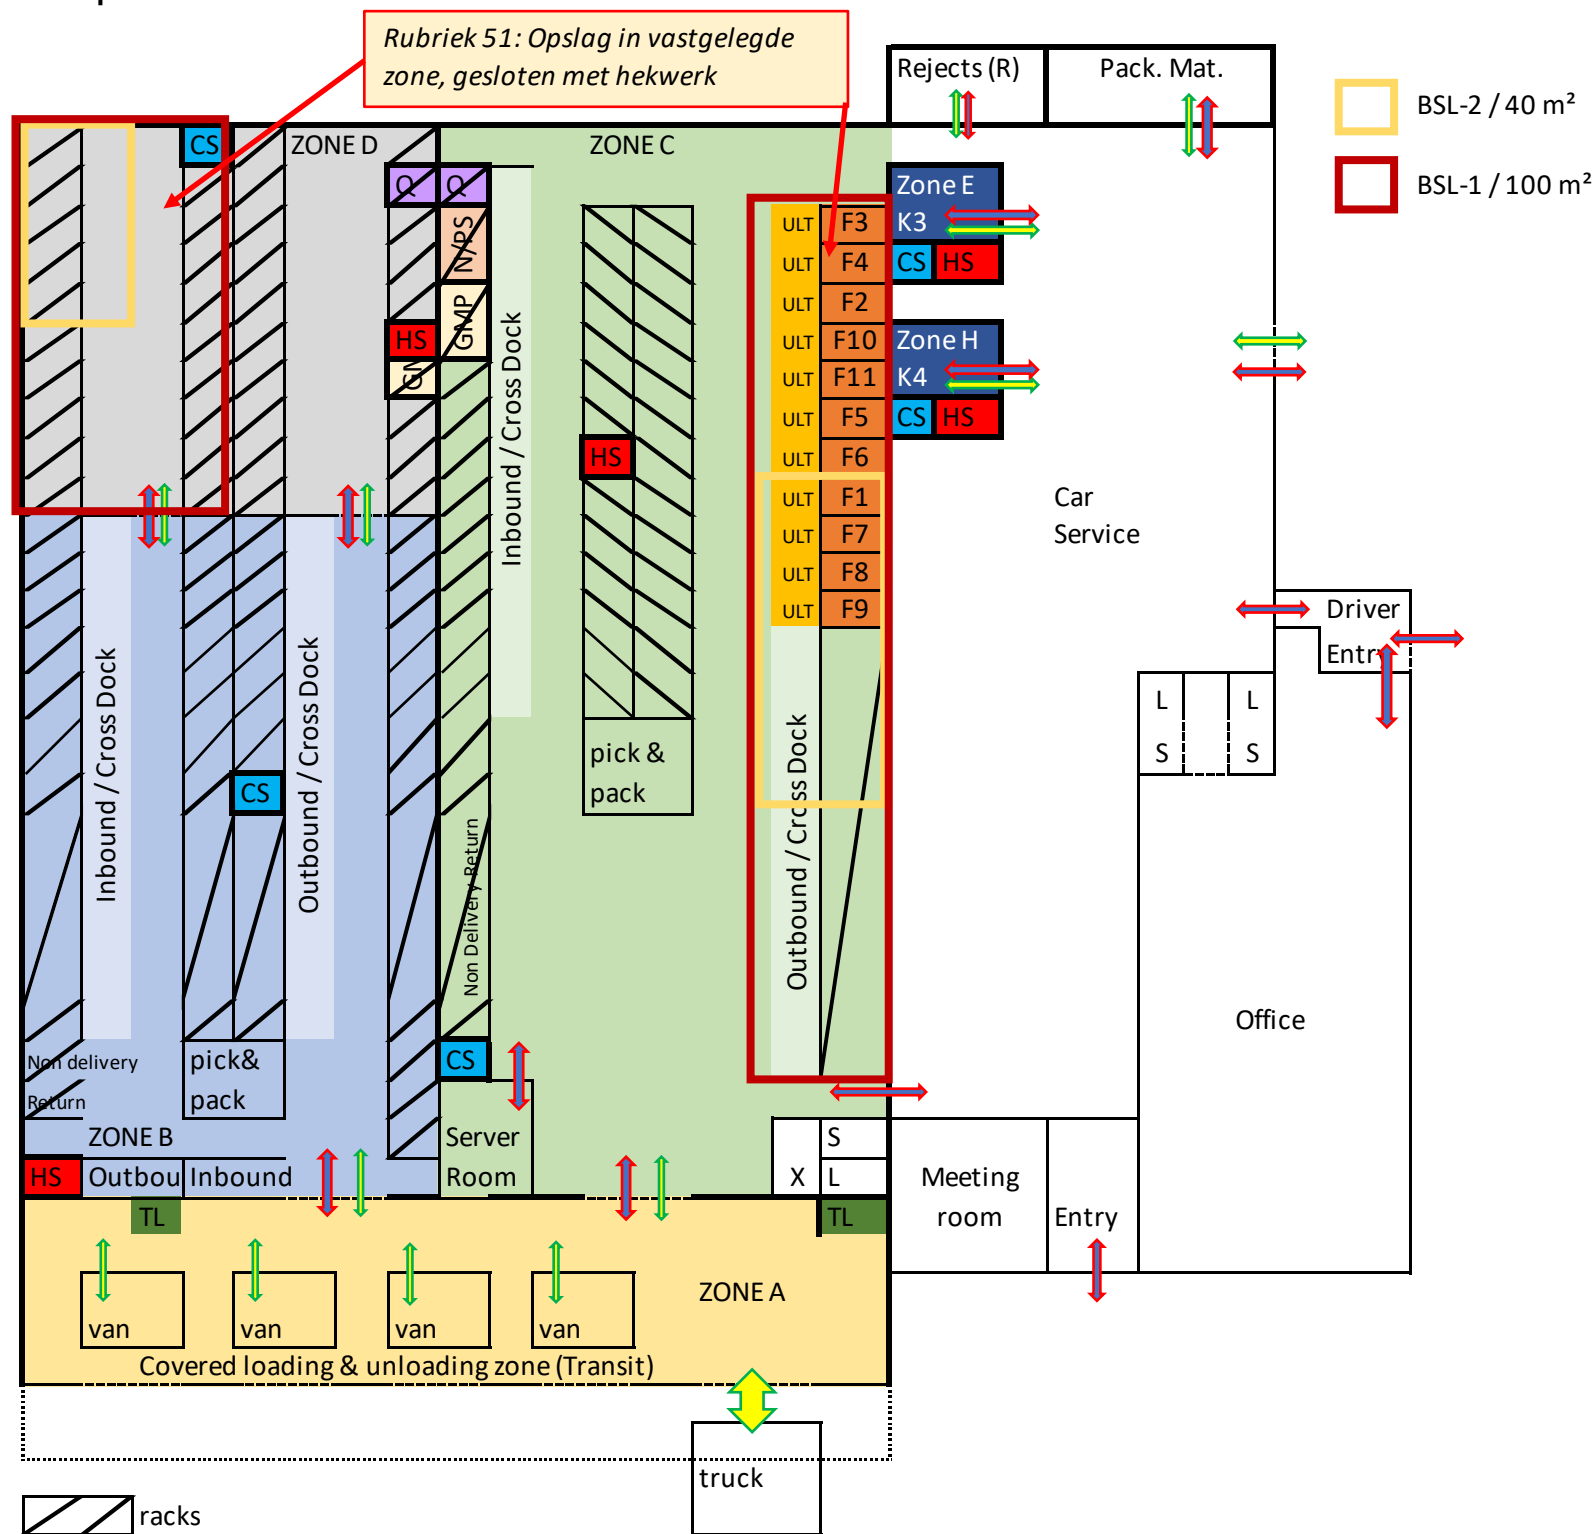

Material flow

Personnel flow

Areas:	K	Koelcel (-20°C Freezer)	F
	L	Lavatory	
	Q	Quarantaine	T
	R	Rejects, recalls, falsified, expired, destruction	
	S	Sink	
	X	Xweb500/Dixell T-control system	

Zone:	B/D	+2°C +8°C	Cold Room
	A	+9°C +15°C	Transit zone
	C	+15°C +25°C	Ambient room
	E/H	-20°C	-20°C Walk-in Freezers
	F	-80°C	-80°C Freezers

T-Monitoring system (Rmoni Wireless):

HS Hotspot

CS Cold spot

TL Transit Logger

ULT Freezer Logger

N/PS: Narc. & Psychotr. (floor level)

GMP: GMP Area

FRM-81 Ver: 9.0

Appl.Date: Apr 01, 2026 09:38:58 (UTC)