


Floorplan RPL1

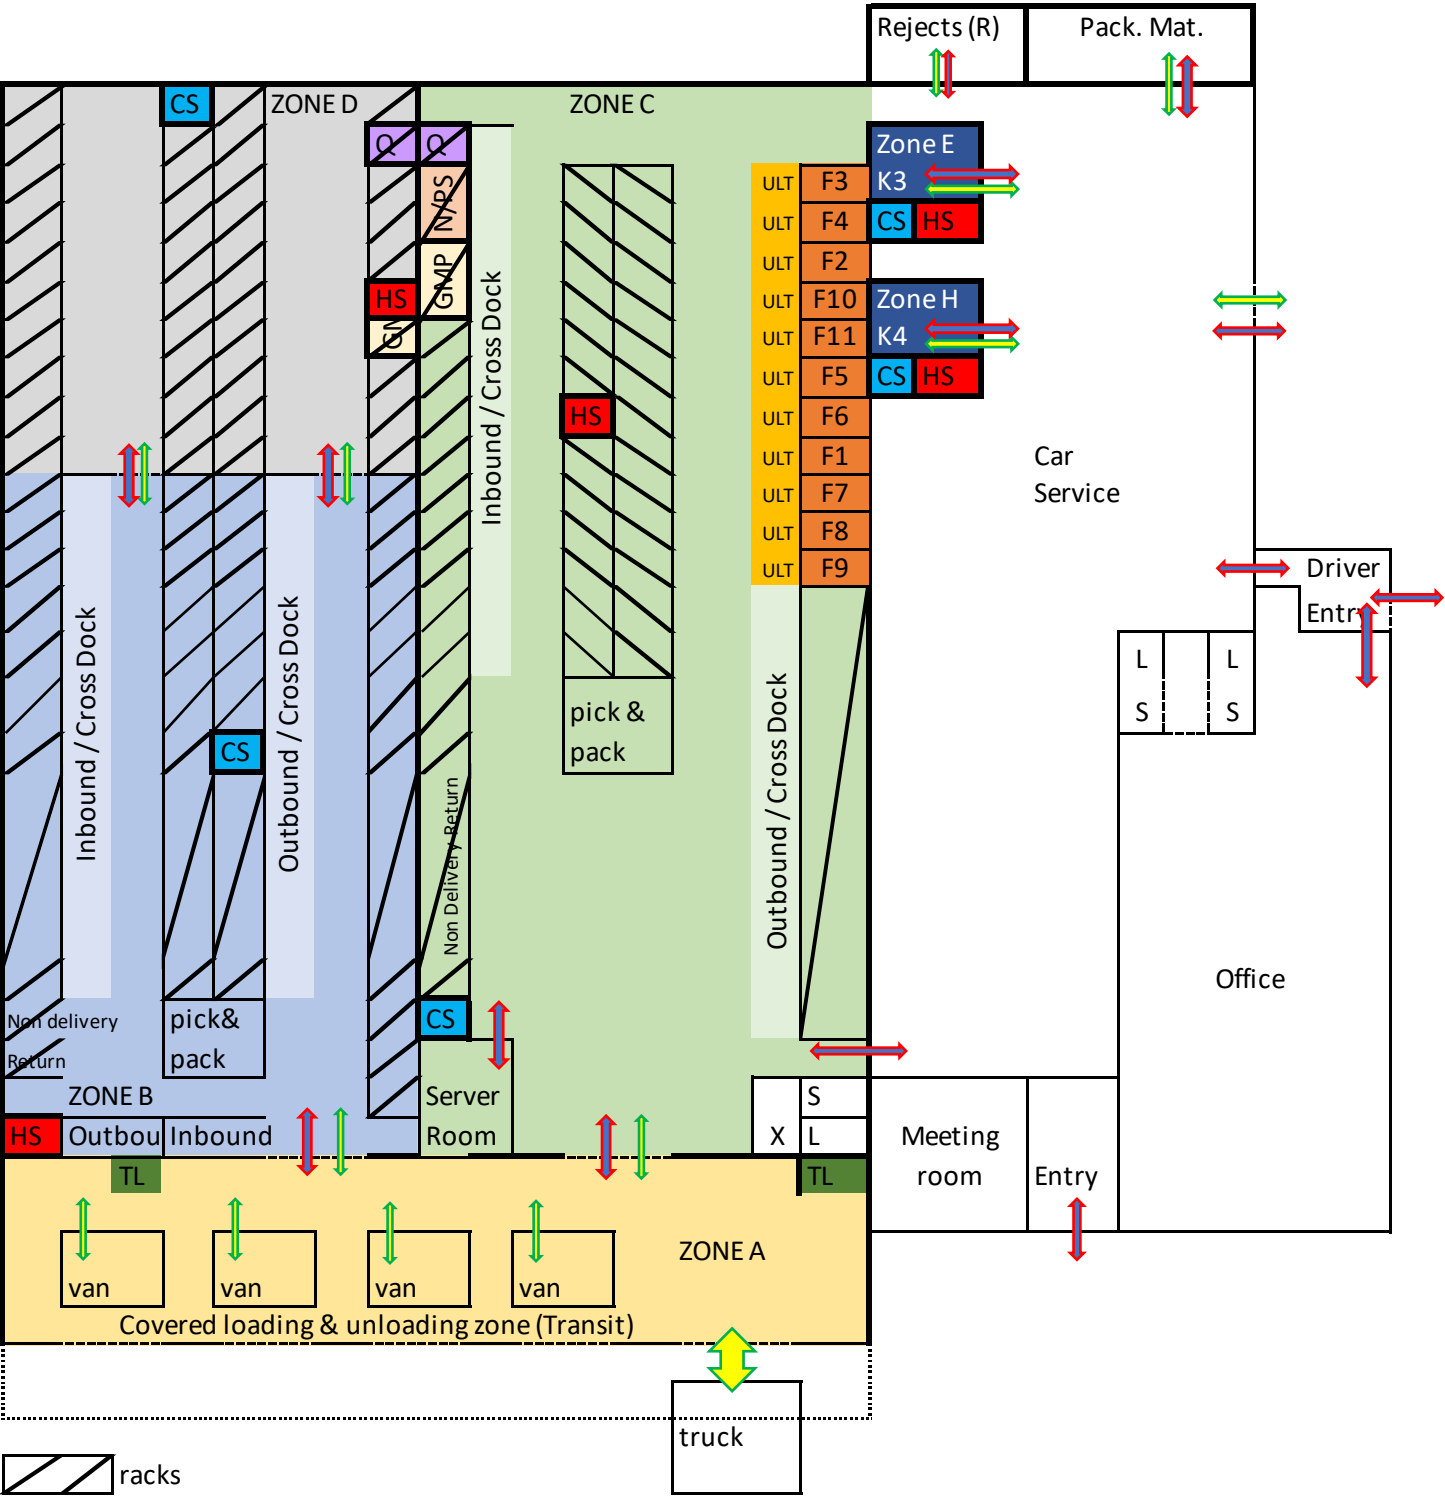

racks

Material flow

Personnel flow

Areas: K Koelcel (-20°C Freezer)
L Lavatory
Q Quarantaine
R Rejects, recalls, falsified, expired, destruction
S Sink
X Xweb500/Dixell T-control system

N/PS: Narc. & Psychotr. (floor level)
GMP: GMP Area

Zone: B/D +2°C +8°C Cold Room
A +9°C +15°C Transit zone
C +15°C +25°C Ambient room
E/H -20°C -20°C Walk-in Freezers
F -80°C -80°C Freezers

T-Monitoring system (Rmoni Wireless):

HS Hotspot
CS Cold spot
TL Transit Logger
ULT ULT Freezer Logger

FRM-81 Ver: 9.0

Appl.Date: Apr 01, 2026 09:38:58 (UTC)